## **Rubix Suspended Installation**



## 220-240V / 50-60Hz IP20

Terminal Labelling: Power

Power

L1 Switched Live
E Earth
N Neutral

Emergency L2 DA/AT3 DA/AT3 Dimming -/D1/DA

Unswitched Live DALI Autotest DALI Autotest

-/D1/DA Analogue/DSI/DALI +/D2/DA Analogue/DSI/DALI L3 Switch Dim / Corridor Function












WARNING: Luminaire must be earthed. Risk of electric shock from LED boards if operated with cover removed. Installation / operation outside of luminaires intended scope invalidates warranty. Suitable only for domestic / light industrial / industrial applications within the scope of EN55015. Tested to compliance with BSEN 60598: specification for general requirements and tests. Must be installed by a suitably qualified person in accordance with all relevant legislation. Ambient operating temperature of 0°C to 25°C. If maximum operating temperature is exceeded luminaire will automatically dim / switch off. Terminal blocks are rated to 16A unless stated otherwise. The light source contained in this luminaire shall only be replaced by the manufacturer or his service agent or a similar qualified person. LUMINAIRES WITH EMERGENCY PACK. When supply is isolated battery output terminals may be live if battery is connected. Isolate mains and battery before servicing. Emergency luminaires require unswitched live connection taken from same phase as switched supply. When unswitched supply is connected status indicator illuminates green, when unswitched supply is disconnected indicator extinguishes and luminaire operates in emergency mode. 24 hour charge period required before undertaking full discharge test. Emergency test sheets provided should be used to record all emergency tests. Batteries should be replaced when 3 hour duration is not met. Excessive switching of permanent live may result in premature battery failure. Battery electrolyte can be harmful to eyes / open wounds, do not puncture, if electrolyte touches skin / eyes flush with water. Do not incinerate batteries.

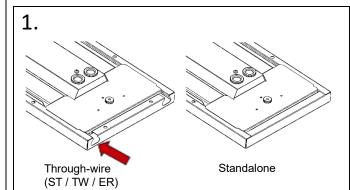


Firstly check fitting type is correct before installation – through-wire versions have cable cut-outs in ends and threaded holes for joining bracket / end plate

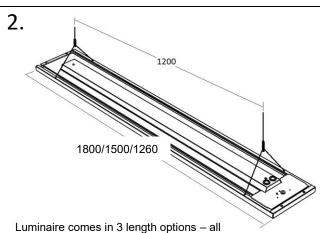

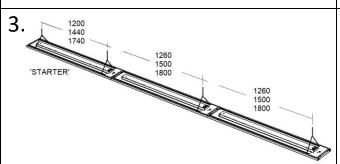


When mounting continuously, STARTER should have x2 suspensions. Subsequent TW fittings require just one... If preferred, each fitting CAN have 2 suspensions fitted (at same centres as STARTER). NOTE, if custom infill pieces are specified, positions of suspensions will be different – always check before installation!!




require suspension points at 1200mm


Secure suspension drops as shown in marked positions.




Screw suspension wire and clutch into ceiling fixture.



Insert toggles of Y suspension kit in to 7mm holes in luminaire



To attach to main wire, depress top of clutch & insert wire




To make electrical connection, loosen thumbnut, remove / lift away cover plate. Pass cable through entry gland and connect to appropriate terminations

6.

## **Rubix Suspended Installation**



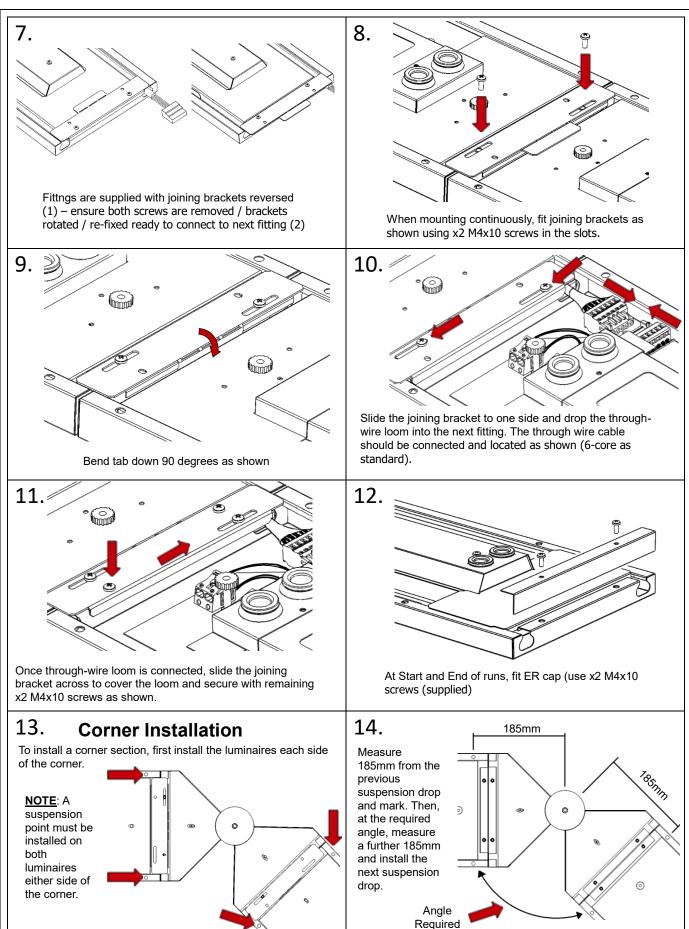

## **Rubix Suspended Installation**



15. 16. The corner covers are The luminaires can be installed on the secured suspension drops. using a single Using the joining brackets provided, secure the screw in corner between the luminaires and connect the the rear. internal wiring loom as per steps 8-11 above. Ensure the earth leads are connected inside the corners. Maintenance 1 Disconnect luminaire before Use a pan pozi screwdriver undertaking any maintenance to remove components. or cleaning. Please contact Dextra for 2 Cleaning should be undertaken on external parts of the assistance with spare luminaire only using a slightly component supply. damp lint free cloth. 3 )In an anticlockwise motion turn Module Driver thumbnuts to release end plates. Battery LED 4 ) Using a pan pozi screwdriver to Circuit remove gear cover. Gear tray will **₩**\$ 0 0 9 \$\$ 0 © \$\$ 0 0 0 \$ now be removable.