



# PRODUCT SPECIFICATION

---

## OPUS WALLPACK



## INTRODUCTION

The Opus Wallpack combines a modern and minimalist design with a durable and robust construction providing both IP65 ingress protection and IK10 impact resistance. With a lensed optical design the Opus Wallpack is designed to maximise spacings between luminaires whilst minimising light pollution. With less than 2.5 percent upward light distribution the Opus Wallpack is suitable for use in a wide range of Environmental Zones where control of nuisance glare is critical.

The Opus Wallpack comes with two lens variants, a broad asymmetric distribution allowing maximum luminaire spacing in walkways alongside buildings, and an open area version with greater forward throw suited to car parks and loading bay applications.

The Opus Wallpack is manufactured with a high pressure die cast aluminium housing and injection moulded polycarbonate cover, powder painted with a salt spray tested external paint finish in either RAL 9006 grey or matt black. With a wide range of options available, the Opus Wallpack can be specified in numerous different lumen outputs up to 5000 lumens, two lens option, lithium emergency and dimming variants and a variety of controls including microwave presence detection, integral photocell for dusk to dawn operation and wireless connectivity for use with our Reacta-Link Wireless system.

This performance and flexibility combines with simplistic and flexible installation with options for side and rear cable entry, and conduit and BESA box installation. We offer a range of wireless control systems providing localised grouping and control as well as comprehensive wireless solutions allowing both standard and emergency luminaires to be centrally monitored.

UK  
CA

CE

IP65

IK10

TM21: L90>80K HOURS

3 STEP MACADAM ELLIPSE

---

## OPUS WALLPACK - APPLICATION

---

- › Commercial / Offices
- › Education
- › Exterior
- › Healthcare / Social Housing
- › Hotel / Leisure
- › Industrial / Manufacturing
- › Parking / Exterior
- › Retail
- › Transport

---

## OPUS WALLPACK - SPECIFICATION

---

### CONSTRUCTION

- › Housing: High pressure die cast aluminium
- › Finish: Polyester powder painted RAL 9006 matt grey
- › Finish: Polyester powder painted RAL 9005 matt black
- › Diffuser: Injection moulded clear polycarbonate
- › Lens: Injection moulded polycarbonate lens
- › IK10
- › IP65

### PERFORMANCE

- › Part L2 compliant
- › 3SDCM Three step Macadams ellipse
- › TM21: L90 at >80,000 Operating Hours
- › Up to 140 luminaire lumens per circuit Watt.

### ENVIRONMENTAL

- › Designed to allow simple replacement of components with commonly available tools in compliance with the Eco Design Directive, please see the installation leaflet for maintenance instructions.
- › Powered by European branded drivers and emergency modules ensuring replacement parts are easily sourced.
- › Every luminaire is labelled with a unique ID number allowing easy identification of spare parts for the lifetime of the product.
- › Contains no single use plastics or polystyrene packaging.
- › Supplied in plain card boxes with paper tape ensuring packaging is easily recycled.

- Designed to allow simple disassembly for end of life recycling.
- UK based manufacturing providing local support throughout the product lifetime and minimising transportation miles.

## **EMERGENCY**

- Available with optional standard, self test and autotest integral emergency with lithium batteries for extended warranty and lifetime.
- Optional Reacta-Link wireless emergency for automated centralised reporting.
- Optional Reacta-Control wireless emergency for automated centralised reporting.
- Optional central battery changeover relay

## **CONTROL**

- Optional compatibility with a range of dimming systems including DALI, DSI and Switch Dimming
- Optional Integral R25 microwave presence and bright out sensor
- Optional integral Reacta-Link for integration with Reacta-Link wireless installations
- Optional integral photocell

## **INSTALLATION**

- Suitable for conduit installation
- Suitable for external surface installation

## **VARIATIONS**

- Available with a wide range of colour temperatures and renderings
- Available in a range of lumen outputs
- Available in grey or black finishes

## OPUS WALLPACK - IMAGES



Opus Wallpack Grey



Opus Wallpack Grey



Opus Wallpack Black



Opus Wallpack Black



A building using the Opus Wallpack



A building using the Opus Wallpack



Crown Buildings, Wrexham using the Opus Wallpack



Crown Buildings, Wrexham using the Opus Wallpack






Southern County Veterinary Specialists using the Opus Wallpack



Southern County Veterinary Specialists using the Opus Wallpack



Southern County Veterinary Specialists using the Opus Wallpack

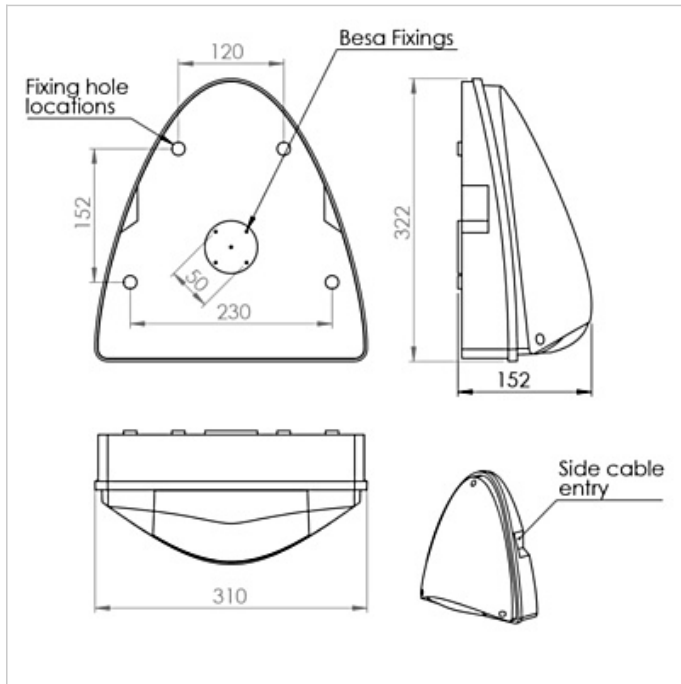

Opus Wallpack

---

## OPUS WALLPACK - WARRANTY

---

At Dextra our commitment to service has been at the forefront throughout our history spanning more than forty years in the UK lighting market. Our service ethos extends beyond design and delivery, we believe supporting your installation throughout the warranty period is equally crucial, whilst the strength and longevity of Dextra Group provides peace of mind that our warranty will be supported throughout.

The Dextra range is supplied with a five year warranty commencing from the date of delivery. During the first three years defects will be repaired on site and the warranty will include both parts and labour. For the final two years drivers, emergency modules, wireless modules, sensors and LED circuits will be supplied free of charge to replace defective components, labour and other associated costs are not included.

Certain ranges and components are subject to exemptions:

- Lithium batteries are provided with a five year warranty. During the first three years defects will be repaired on site and the warranty will include both parts and labour. For the final two years replacement batteries will be supplied free of charge to replace defective components. Five year warranty became effective as of 03/02/25, Lithium emergency luminaires supplied prior to this date are supported with a three year on site warranty only. Labour and other associated costs are not included. Nickel Metal Hydride and Nickel Cadmium batteries are provided with a one year warranty for parts and labour.
- Emergency luminaires including AME LED, EXI LED, EXI2 LED, EXI Track, HBE LED, HBE2 LED, OAT2 LED, OEZ LED and Twinspot are supplied with a one year warranty for parts and labour. Lithium variants suffixed with the 5YR part code, the Autotest emergency with the LA3 part code and wireless variants with LA3RC or LSTR part codes are supplied with a five year warranty. For these extended warranty variants for the first three years defects will be repaired on site and the warranty will include both parts and labour. For the final two years replacement batteries will be supplied free of charge to replace defective components.
- Protec Micro, PTECF7 Fire Rated Downlights, Serenus and the Opus Sconce are provided with a five year replacement luminaire only warranty. Protec FR Fire Rated Downlights are provided with a 2 year replacement luminaire only warranty.
- Controls systems such as standalone sensors, switches, marshalling boxes and cabling are provided with a one year warranty for both parts and labour. DALI control systems are provided with a two year warranty for both parts and labour.
- LEDextra ranges are supplied with a three year parts or replacement luminaire only warranty with the exception of the IMPR RGBW, the Runway RGBW, the MOD RGBW, Tanek RGBW and the DexRing. These five ranges are supplied with our standard five year warranty during which defects within the first three years will be repaired on site and the warranty includes both parts and labour. For the final two years free of charge replacement components only will be supplied to rectify any failures but labour and other associated costs are not included.
- LEDEX ranges are supplied with a three year replacement luminaire only warranty.



- The Decorative Pendant ranges, Bebo, Dene, Nova, Fino and Stix are supplied with a 3 year replacement luminaire only warranty.

All warranties are subject to correct use of the product and will be invalidated by misuse, for example incorrect installation, unsuitable environmental conditions or incorrect maintenance. It is the duty of the customer to ensure that all the fault lies with the luminaire prior to requesting replacement parts or site repairs. In the event that no defect is found with the product our costs for attending site will be recharged to the customer and credit will not be issued against returned products. No consequential losses incurred resulting from any defect with our product will be reimbursed.

Given the nature of LED technology a small percentage of LEDs may fail during the lifetime of a luminaire, this does not cause a reduction in lumen output. As such LED luminaires are only deemed to be faulty for warranty purposes when in excess of ten percent of LEDs have failed in a single luminaire.

On site repair of products under warranty will be undertaken during normal working hours, 9am to 5pm Monday to Friday, and will require unrestricted access to luminaires. Where required Dextra will provide access equipment to carry out repairs at height, should luminaires have been installed in locations where reasonable provision for maintenance access has not been made we reserve the right to supply replacement product only. On site warranty repairs will only be undertaken on the mainland of the UK and Ireland, in all other locations replacement product only will be provided.

**If you require any assistance with regards to our products please contact our Customer Services department on 01747 858100.**

## OPUS WALLPACK - ORDER CODES

### LUMINAIRE CODES

Code	Description	Power	Llm/W
OPUWP L15 AS	Opus Wallpack, Grey, 1,213llm, Asymmetric, Colour 74	10.8W	112
OPUWP L25 AS	Opus Wallpack, Grey, 2,005llm, Asymmetric, Colour 74	18.8W	106
OPUWP L30 OA	Opus Wallpack, Grey, 2,494llm, Open Area, Colour 74	17.8W	140
OPUWP L40 OA	Opus Wallpack, Grey, 3,325llm, Open Area, Colour 74	24.0W	139
OPUWP L50 OA	Opus Wallpack, Grey, 4,156llm, Open Area, Colour 74	30.9W	134

### DIMMING

Code	Description
A	DALI Digital Addressable Lighting Interface
D	DSI Digital Dimming
H	HFR Analogue 1-10v
C	Bi-Level Dimming For Standalone Switched Sensor

### CONTROL

Code	Description
R25E	Reacta 25, Presence & Bright Out, On / Off, 2.5-4M
R25C*	Reacta 25, Presence & Bright Out, Bi-Level Dimming, 2.5-4M
PH	Photocell
RLI	Reacta-Link, Wireless Enabled Luminaire
RLM	Reacta-Link, Wireless, Presence & Bright Out, 2.5-4M
RC	Reacta-Control, Wireless Enabled Luminaire
RCMC*	Reacta-Control, Presence & Bright Out, Bi-level Dimming, 2.5-4M
RCME	Reacta-Control, Presence & Bright Out, On / Off, 2.5-4M

[Please click here for full details on our wireless controls.](#)

\*Bi-Level Dimming will only dim the luminaire to 10% during absence and brightout, it will not turn the luminaire off.

All R25C, RCMC, R25E & RCME sensors require the integral photocell also to ensure dusk to dawn operation

### EMERGENCY

Code	Description
LE3	Lithium Standard Emergency 3 Hour
LS3	Lithium Selftest Emergency 3 Hour
LA3	Lithium Autotest Emergency 3 Hour
LSTR	Lithium Reacta-Link Emergency 3 Hour
LA3RC	Lithium Reacta-Control Emergency 3 Hour

### MISCELLANEOUS

Code	Description
C**	C727, C73
BL	Black Finish
TRS	Tamper Resistant Screws
TRS INSTALL KIT	Tamper Resistant Compatible Screwdriver Heads
LSF	Low Smoke Zero Halogen

# Opus Wallpack Installation

220-240V / 50-60Hz

IP65

IK10

## Terminal Labelling:


Power	
L1	Switched Live
E	Earth
N	Neutral
Emergency	
L2	Unswitched Live
DA/AT3	DALI Autotest
DA/AT3	DALI Autotest
Dimming	
-D1/DA	Analogue/DSI/DALI
+D2/DA	Analogue/DSI/DALI
L3	Switch Dim / Corridor Function



**WARNING:** Luminaire must be earthed. Risk of electric shock from LED boards if operated with cover removed. Installation / operation outside of luminaires intended scope invalidates warranty. Suitable only for domestic / light industrial / industrial applications within the scope of EN55015. Tested to compliance with BSEN 60598: specification for general requirements and tests. Must be installed by a suitably qualified person in accordance with all relevant legislation. Ambient operating temperature of 0°C to 25°C. If maximum operating temperature is exceeded luminaire will automatically dim / switch off. Terminal blocks are rated to 16A unless stated otherwise. The light source contained in this luminaire shall only be replaced by the manufacturer or his service agent or a similar qualified person. **LUMINAIRES WITH EMERGENCY PACK:** When supply is isolated battery output terminals may be live if battery is connected. Isolate mains and battery before servicing. Emergency luminaires require unswitched live connection taken from same phase as switched supply. When unswitched supply is connected status indicator illuminates green, when unswitched supply is disconnected indicator extinguishes and luminaire operates in emergency mode. 24 hour charge period required before undertaking full discharge test. Emergency test sheets provided should be used to record all emergency tests. Batteries should be replaced when 3 hour duration is not met. Excessive switching of permanent live may result in premature battery failure. Battery electrolyte can be harmful to eyes / open wounds, do not puncture, if electrolyte touches skin / eyes flush with water. Do not incinerate batteries.



1.

Loosen off the 3 screws to remove cover.

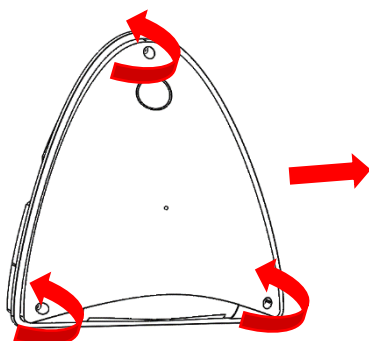

2.


Fitting suitable for multiple mounting methods/cable entry points – drill to suit.

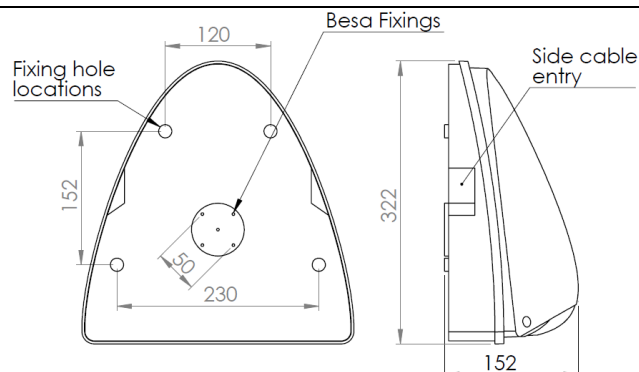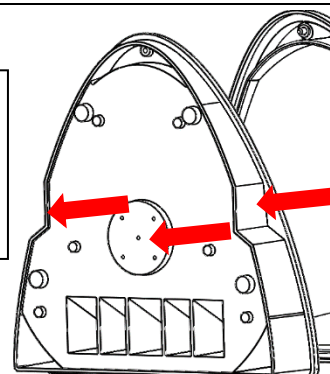

Mark out & prepare wall as required.


3.

After mounting the fitting to the wall and installing any IP glands necessary, wire into the appropriate terminals, making sure to clamp them in place with the wire clamp provided.

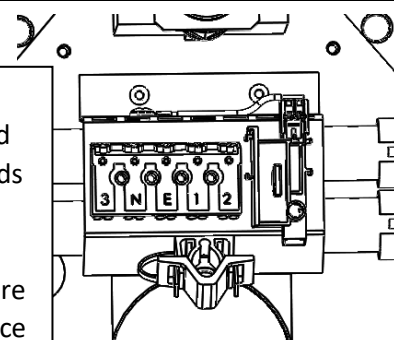

4.

Photocell

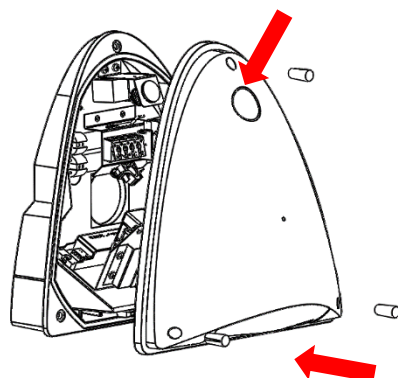

Ensuring all holes drill have been sealed to IP65, refit cover and fasten the screws. Fit cover caps in each hole in the orientation if the keys.

## NOTES:

- Full IP ratings only apply when luminaire is mounted with the photocell at the top.
- It is the responsibility of the installer to ensure the IP ratings are maintained during installation of the fitting.
- This luminaire is only suitable for domestic, light industrial and industrial environments which are within the scope of EN 55015.
- Not for use in hazardous areas, areas of excessive heat or where airborne fatty substances may be present.
- Operating temperature is 0°C to 25°C. If the temperature exceeds the drivers maximum TA there is a safety mechanism where the driver will either dim or switch off to allow it to cool.

# Opus Wallpack Installation

## Maintenance

- ① Disconnect luminaire before undertaking any maintenance or cleaning.
- ② Cleaning should be undertaken on external parts of the luminaire only using a slightly damp lint free cloth.
- ③ Using a pan pozi screwdriver loosen x3 screws to remove cover.
- ④ To access Led circuit use a torx screwdriver to remove x3 screws from cover.
- ⑤ To remove gear tray and components use a pan pozi screwdriver.
- ⑥ Please contact Dextra for assistance with spare component supply.

