

PRODUCT SPECIFICATION

RUBIX FLUSH



INTRODUCTION

To complement the Rubix Recessed we are pleased to announce the launch of the Rubix Flush, utilising the same Rubix optic design but without the surrounding halo offering a minimalist appearance that sits flush with the ceiling. The nine individual cells offer precise optical control allowing for spacing's up to three by three meters whilst still maintaining 400 lux on the working plane at typical ceiling heights and also providing compliance with UGR 19 and the 3000 candela BSEN 12464 requirement.

The metal surround provided with the Rubix range can be easily modified to suit a wide range of ceiling variants such as exposed T, concealed grid or unusual sizes such as 300mm x 300mm, 500mm x 500mm or 750mm x 750mm, this is combined with a wide range of lumen outputs and dimming and lithium emergency variants ensuring that the Rubix can be customised to your specific requirements. We offer a range of wireless control systems providing localised grouping and control as well as comprehensive wireless solutions allowing both standard and emergency luminaires to be centrally monitored.

UK
DA

CE

IP20

TM21: L90>60K HOURS / L80>90K HOURS

3 STEP MACADAM ELLIPSE

RUBIX FLUSH - APPLICATION

- › Commercial / Offices
- › Education

RUBIX FLUSH - SPECIFICATION

CONSTRUCTION

- › Housing: 0.7mm CR4 steel
- › Finish: Polyester powder painted BS 00E55 matt white 60% gloss
- › Finish: Polyester powder painted RAL 9006 matt grey
- › Finish: Polyester powder painted RAL 9005 matt black
- › Diffuser: Injection moulded high transmission opal polycarbonate cell with micro silver aluminium inserts and injection moulded clip on bezel
- › IP20

PERFORMANCE

- › Part L2 compliant
- › BSEN 12464-1:2011 3000 Candela 65° and UGR 19 compliance
- › 3SDCM Three step Macadams ellipse
- › TM21: L90>60K Hours / L80>90K Hours
- › Up to 136 luminaire lumens per circuit Watt.

ENVIRONMENTAL

- › Designed to allow simple replacement of components with commonly available tools in compliance with the Eco Design Directive, please see the installation leaflet for maintenance instructions.
- › Powered by European branded drivers and emergency modules ensuring replacement parts are easily sourced.
- › Every luminaire is labelled with a unique ID number allowing easy identification of spare parts for the lifetime of the product.
- › Contains no single use plastics or polystyrene packaging.
- › Supplied in plain card boxes with paper tape ensuring packaging is easily recycled.
- › Designed to allow simple disassembly for end of life recycling.
- › UK based manufacturing providing local support throughout the product lifetime and minimising transportation miles.

EMERGENCY

- › Available with optional standard, self test and autotest integral emergency with lithium batteries for extended warranty and lifetime.
- › Optional Reacta-Link wireless emergency for automated centralised reporting.

- › Optional Reacta-Control wireless emergency for automated centralised reporting.
- › Optional central battery changeover relay

CONTROL

- › HFR 1-10V analogue dimming
- › Optional compatibility with a range of dimming systems including DALI, DSI and Switch Dimming
- › Optional Integral R44 presence and daylight sensor
- › Optional Integral Reacta-Air wireless presence and daylight regulations sensor
- › Optional integral Reacta-Link for integration with Reacta-Link wireless installations
- › Optional integral Reacta-Control for integration with Reacta-Control wireless installations

INSTALLATION

- › Suitable for lay-in installation in exposed T ceilings
- › Suitable for pull-up installation in concealed grid ceilings
- › Suitable for plasterboard installation when purchased with the appropriate plasterboard kit
- › Suitable for conduit installation
- › Alugrid 08 and 16 compatible options available. Please see miscellaneous ordering codes.


VARIATIONS

- › Available with a wide range of colour temperatures and renderings
- › Available in a range of housing sizes and lumen outputs
- › Available in white, black or grey finishes
- › Available with a range of cell colours
- › Available in 500x500, 750x750 and air handling variants.


RUBIX FLUSH - IMAGES




Rubix Flush Opal Cells

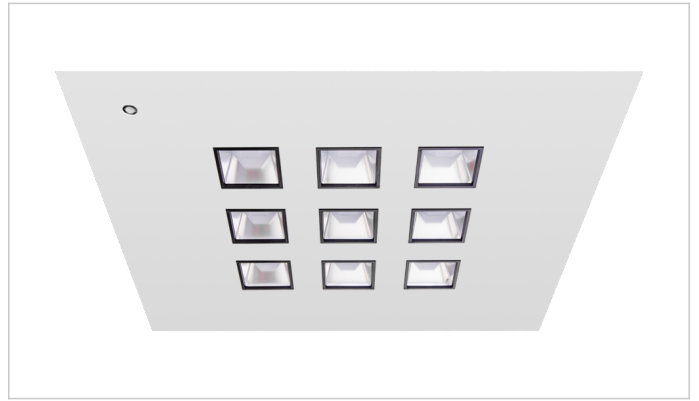

Rubix Flush Black Cells

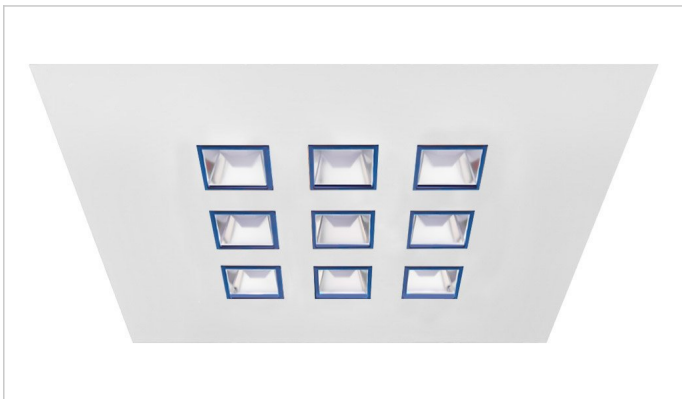

Rubix Flush Blue Cells

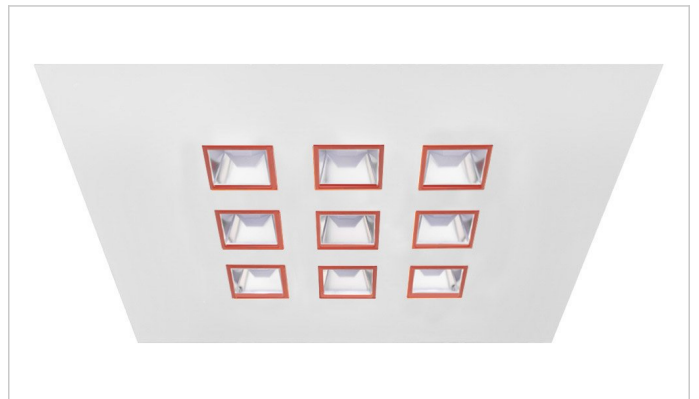

Rubix Flush Red Cells




Rubix Flush Orange Cells



Rubix Flush 1200x600 Opal Cells



Rubix Flush 1200x600 Black Cells

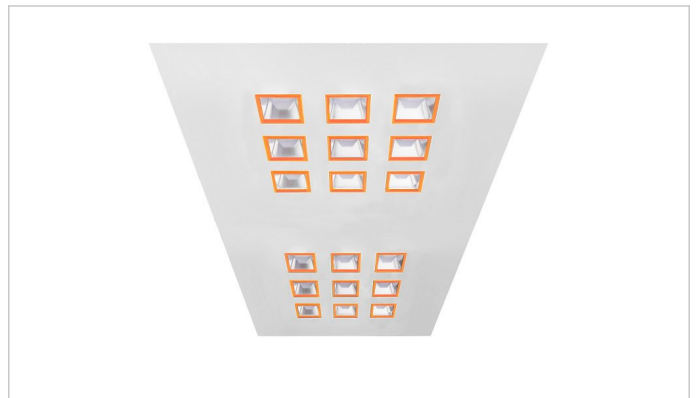

Rubix Flush 1200x600 Orange Cells



Cardiff & Vale College using the Rubix Flush



A school hall using the Rubix Flush and Runway




Galeri Caernarfon using the Rubix Flush with plasterboard kit



Galeri Caernarfon using the Rubix Flush



Galeri Caernarfon using the Duet LED & Rubix Flush

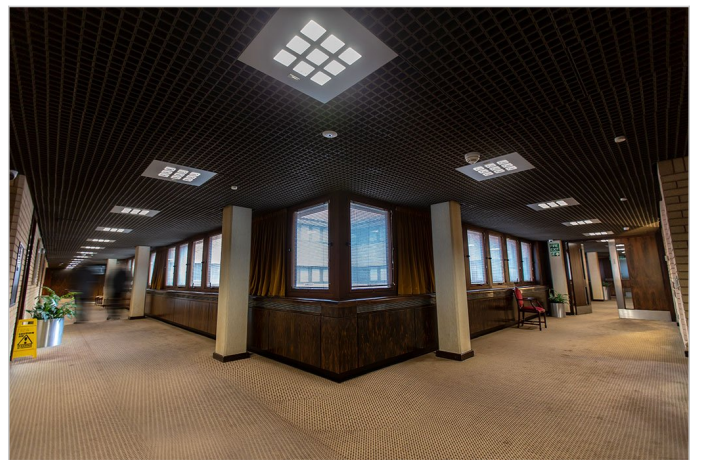

Gateshead Civic Centre using the Rubix Flush




Gateshead Civic Centre using the Rubix Flush



Gateshead Civic Centre using the Rubix Flush

Gateshead Civic Centre using the Rubix Flush

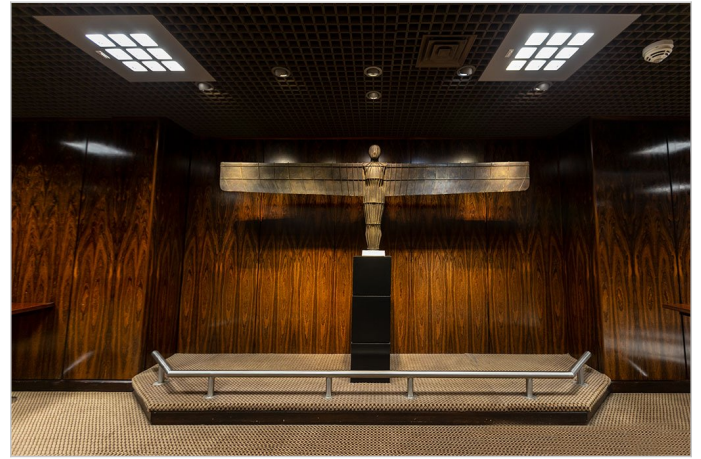

Gateshead Civic Centre using the Rubix Flush



Gateshead Civic Centre using the Rubix Flush



Gateshead Civic Centre using the Rubix Flush



Gateshead Civic Centre using the Rubix Flush



De Montfort University using the Rubix Flush



De Montfort University using the Rubix Flush



De Montfort University using the Rubix Flush



De Montfort University using the Rubix Flush



De Montfort University using the Rubix Flush



De Montfort University using the Rubix Flush



GCU CEE Building in Glasgow using the Rubix Flush



GCU CEE Building in Glasgow using the Rubix Flush



GCU CEE Building in Glasgow using the Rubix Flush

GCU CEE Building in Glasgow using the Rubix Flush




GCU CEE Building in Glasgow using the Rubix Flush




GCU CEE Building in Glasgow using the Rubix Flush


RUBIX FLUSH - TECHNICAL

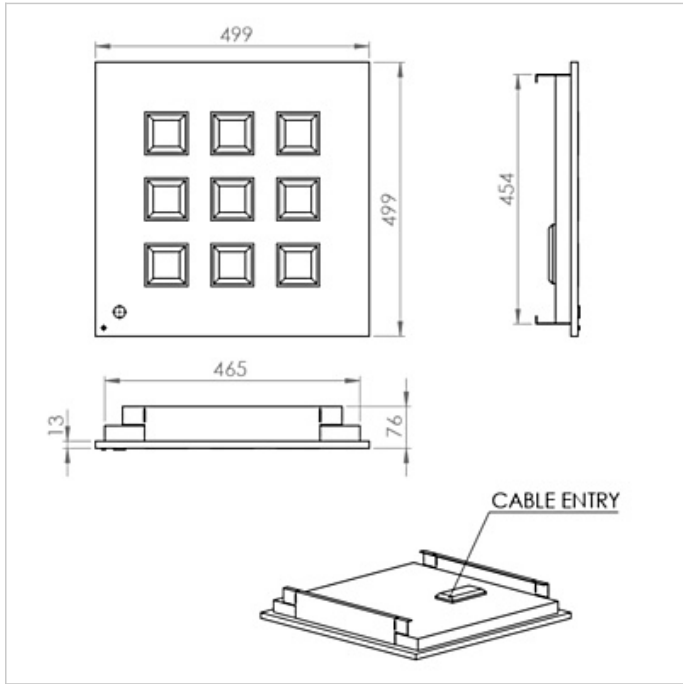


Rubix Flush Pull-Up 500x500

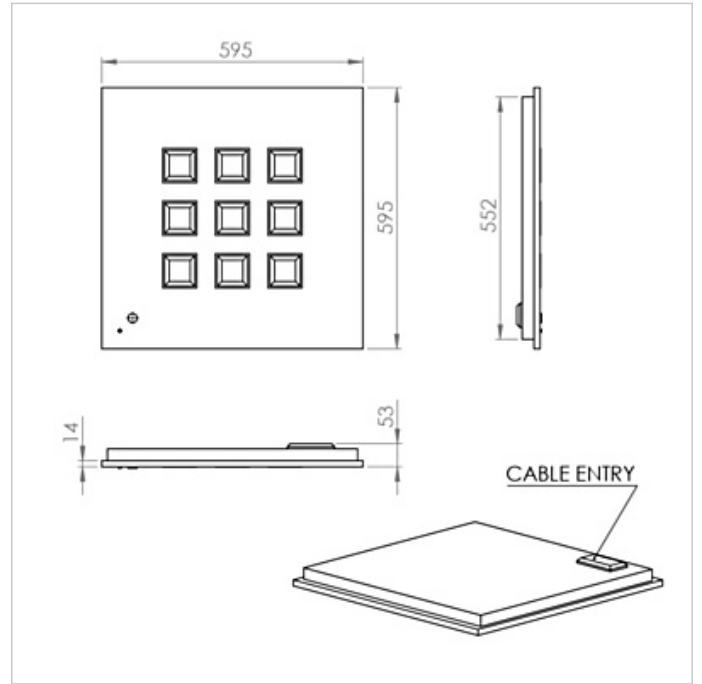


Rubix Flush Lay-In 600x600

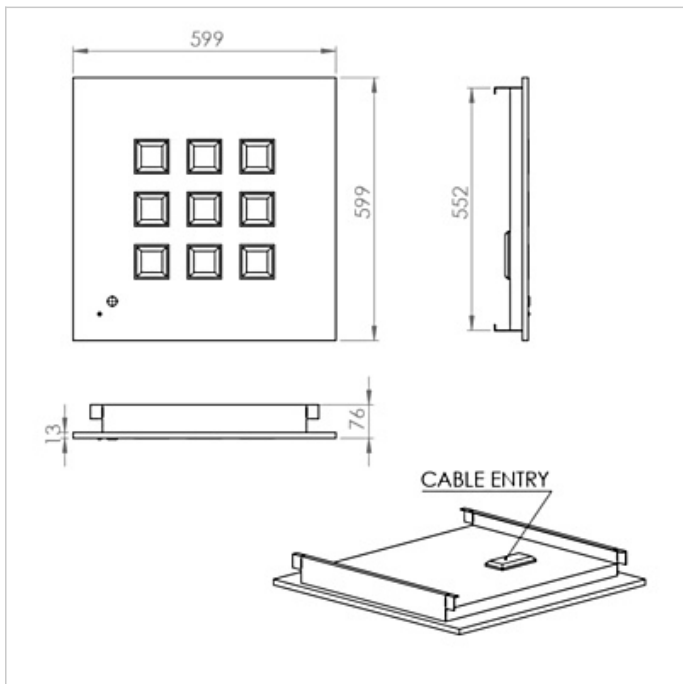


Rubix Flush Pull-Up 600x600

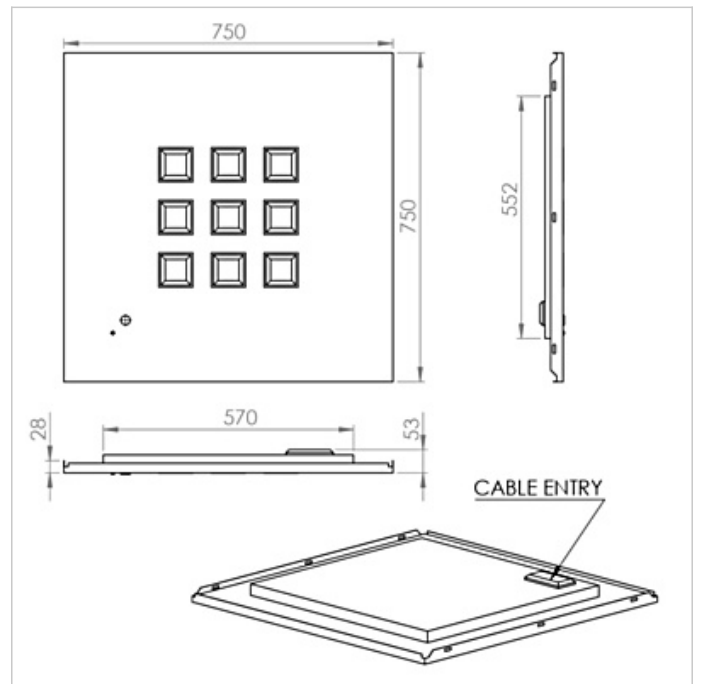

Rubix Flush Lay-In 750x750

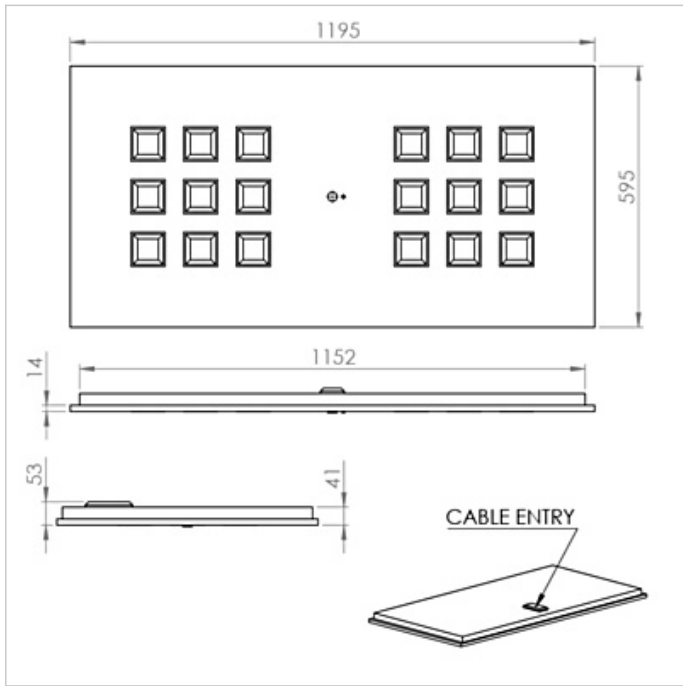

Rubix Flush Lay-In 1200x600

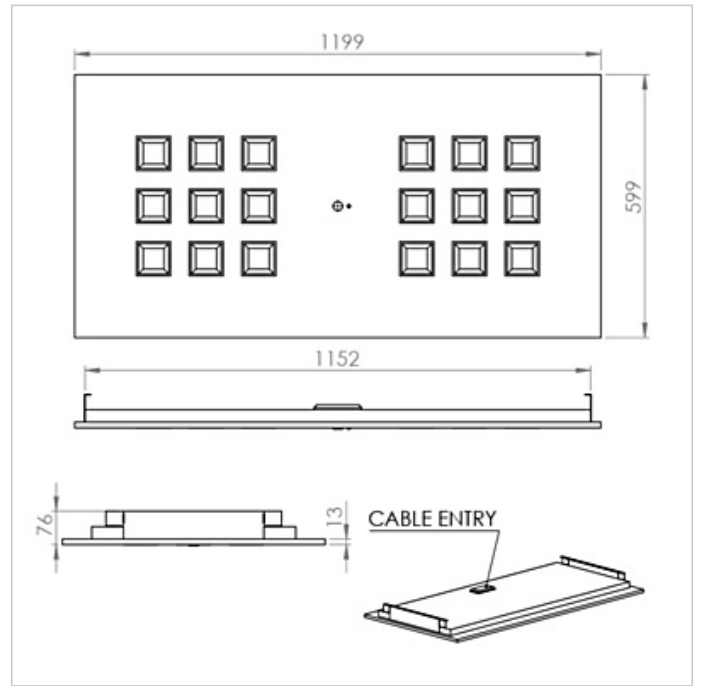

Rubix Flush Pull-Up 1200x600

RUBIX FLUSH - WARRANTY

At Dextra our commitment to service has been at the forefront throughout our history spanning more than forty years in the UK lighting market. Our service ethos extends beyond design and delivery, we believe supporting your installation throughout the warranty period is equally crucial, whilst the strength and longevity of Dextra Group provides peace of mind that our warranty will be supported throughout.

The Dextra range is supplied with a five year warranty commencing from the date of delivery. During the first three years defects will be repaired on site and the warranty will include both parts and labour. For the final two years drivers, emergency modules, wireless modules, sensors and LED circuits will be supplied free of charge to replace defective components, labour and other associated costs are not included.

Certain ranges and components are subject to exemptions:

- Lithium batteries are provided with a five year warranty. During the first three years defects will be repaired on site and the warranty will include both parts and labour. For the final two years replacement batteries will be supplied free of charge to replace defective components. Five year warranty became effective as of 03/02/25, Lithium emergency luminaires supplied prior to this date are supported with a three year on site warranty only. Labour and other associated costs are not included. Nickel Metal Hydride and Nickel Cadmium batteries are provided with a one year warranty for parts and labour.
- Emergency luminaires including AME LED, EXI LED, EXI2 LED, EXI Track, HBE LED, HBE2 LED, OAT2 LED, OEZ LED and Twinspot are supplied with a one year warranty for parts and labour. Lithium variants suffixed with the 5YR part code, the Autotest emergency with the LA3 part code and wireless variants with LA3RC or LSTR part codes are supplied with a five year warranty. For these extended warranty variants for the first three years defects will be repaired on site and the warranty will include both parts and labour. For the final two years replacement batteries will be supplied free of charge to replace defective components.
- Protec Micro, PTECF7 Fire Rated Downlights, Serenus and the Opus Sconce are provided with a five year replacement luminaire only warranty. Protec FR Fire Rated Downlights are provided with a 2 year replacement luminaire only warranty.
- Controls systems such as standalone sensors, switches, marshalling boxes and cabling are provided with a one year warranty for both parts and labour. DALI control systems are provided with a two year warranty for both parts and labour.
- LEDextra ranges are supplied with a three year parts or replacement luminaire only warranty with the exception of the IMPR RGBW, the Runway RBGW, the MOD RGBW, Tanek RGBW and the DexRing. These five ranges are supplied with our standard five year warranty during which defects within the first three years will be repaired on site and the warranty includes both parts and labour. For the final two years free of charge replacement components only will be supplied to rectify any failures but labour and other associated costs are not included.
- LEDEX ranges are supplied with a three year replacement luminaire only warranty.

- The Decorative Pendant ranges, Bebo, Dene, Nova, Fino and Stix are supplied with a 3 year replacement luminaire only warranty.

All warranties are subject to correct use of the product and will be invalidated by misuse, for example incorrect installation, unsuitable environmental conditions or incorrect maintenance. It is the duty of the customer to ensure that all the fault lies with the luminaire prior to requesting replacement parts or site repairs. In the event that no defect is found with the product our costs for attending site will be recharged to the customer and credit will not be issued against returned products. No consequential losses incurred resulting from any defect with our product will be reimbursed.

Given the nature of LED technology a small percentage of LEDs may fail during the lifetime of a luminaire, this does not cause a reduction in lumen output. As such LED luminaires are only deemed to be faulty for warranty purposes when in excess of ten percent of LEDs have failed in a single luminaire.

On site repair of products under warranty will be undertaken during normal working hours, 9am to 5pm Monday to Friday, and will require unrestricted access to luminaires. Where required Dextra will provide access equipment to carry out repairs at height, should luminaires have been installed in locations where reasonable provision for maintenance access has not been made we reserve the right to supply replacement product only. On site warranty repairs will only be undertaken on the mainland of the UK and Ireland, in all other locations replacement product only will be provided.

If you require any assistance with regards to our products please contact our Customer Services department on 01747 858100.

RUBIX FLUSH - ORDER CODES

LUMINAIRE CODES

Pull-up

Code	Description	Power	Llm/W
RBXPFL55 L32	Rubix Flush Pull-Up, 500x500, 2,546lIm, Opal Cell, Colour 84	18.0W	141
RBXPFL55 L40	Rubix Flush Pull-Up, 500x500, 3,291lIm, Opal Cell, Colour 84	23.0W	143
RBXPFL55 L45	Rubix Flush Pull-Up, 500x500, 3,580lIm, Opal Cell, Colour 84	25.6W	140
RBXPFL L32	Rubix Flush Pull-Up, 600x600, 2,546lIm, Opal Cell, Colour 84	18.0W	141
RBXPFL L40	Rubix Flush Pull-Up, 600x600, 3,291lIm, Opal Cell, Colour 84	23.0W	143
RBXPFL L45	Rubix Flush Pull-Up, 600x600, 3,580lIm, Opal Cell, Colour 84	25.6W	140
RBXPFL75 L32	Rubix Flush Pull-Up, 750x750, 2,546lIm, Opal Cell, Colour 84	18.0W	141
RBXPFL75 L40	Rubix Flush Pull-Up, 750x750, 3,291lIm, Opal Cell, Colour 84	23.0W	143
RBXPFL75 L45	Rubix Flush Pull-Up, 750x750, 3,580lIm, Opal Cell, Colour 84	25.6W	140
RBXPFL 126 L64	Rubix Flush Pull-Up, 1200x600, 5,330lIm, Opal Cell, Colour 84	33.0W	162
RBXPFL 126 L80	Rubix Flush Pull-Up, 1200x600, 6,660lIm, Opal Cell, Colour 84	41.4W	161
RBXPFL 126 L90	Rubix Flush Pull-Up, 1200x600, 7,495lIm, Opal Cell, Colour 84	46.3W	162

For plasterboard ceilings please specify lay-in luminaire and appropriate plasterboard kit.

Lay-in

Code	Description	Power	Llm/W
RBXRFL L32	Rubix Flush Lay-In, 600x600, 2,546lIm, Opal Cell, Colour 84	18.0W	141
RBXRFL L40	Rubix Flush Lay-In, 600x600, 3,291lIm, Opal Cell, Colour 84	23.0W	143
RBXRFL L45	Rubix Flush Lay-In, 600x600, 3,580lIm, Opal Cell, Colour 84	25.6W	140
RBXRFL 126 L64	Rubix Flush Lay-In, 1200x600, 5,330lIm, Opal Cell, Colour 84	33.0W	162
RBXRFL 126 L80	Rubix Flush Lay-In, 1200x600, 6,660lIm, Opal Cell, Colour 84	41.4W	161
RBXRFL 126 L90	Rubix Flush Lay-In, 1200x600, 7,495lIm, Opal Cell, Colour 84	46.3W	162

For Alugrid compatible versions please specify lay-in luminaire with correct ALU suffix shown in miscellaneous ordering codes

OPTIC

Code	Description
BLK	Black Cell
BLE	Blue Cell
ORA	Orange Cell
RED	Red Cell

DIMMING

Code	Description
A	DALI Digital Addressable Lighting Interface
S	Switch Dimming
D	DSI Digital Dimming
H	HFR Analogue 1-10v
C	Bi-Level Dimming For Standalone Switched Sensor

CONTROL

Code	Description
R44	Reacta 44, Presence & Daylight, 2.5-7M
RAS	Reacta-Air Bluetooth, Wireless, Presence & Daylight, 2.5-3M
RLI	Reacta-Link, Wireless Enabled Luminaire
RLS	Reacta-Link Wireless, Presence & Daylight, 2.5M-5M
RC	Reacta-Control, Wireless Enabled Luminaire
RCS	Reacta-Control Wireless, Presence & Daylight, 2.5-4M

Please click [here](#) for full details on our wireless controls.

EMERGENCY

Code	Description
LE3	Lithium Standard Emergency 3 Hour
LS3	Lithium Selftest Emergency 3 Hour
LA3	Lithium Autotest Emergency 3 Hour


LSTR	Lithium Reacta-Link Emergency 3 Hour
LA3RC	Lithium Reacta-Control Emergency 3 Hour
CB	Central Battery, Please Specify 110V or 230V when Ordering

MISCELLANEOUS

Code	Description
C**	Select Colour Temperature and Rendering; C827, C83, C84, C85, C865, C93, C94
BL	Black Finish
GY	Grey Finish
LSF	Low Smoke Zero Halogen
ALU16	Alugrid 15/16 Ceiling Compatible
ALU08	Alugrid 15/08 Ceiling Compatible

Rubix Flush (Lay-In) Installation


220-240V / 50-60Hz
IP20

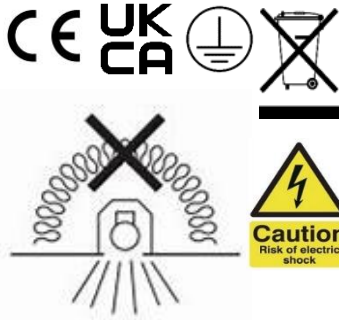

WARNING: Luminaire must be earthed. Risk of electric shock from LED boards if operated with cover removed. Installation / operation outside of luminaires intended scope invalidates warranty. Suitable only for domestic / light industrial / industrial applications within the scope of EN55015. Tested to compliance with BSEN 60598: specification for general requirements and tests. Must be installed by a suitably qualified person in accordance with all relevant legislation. Ambient operating temperature of 0°C to 25°C. If maximum operating temperature is exceeded luminaire will automatically dim / switch off. Terminal blocks are rated to 16A unless stated otherwise. The light source contained in this luminaire shall only be replaced by the manufacturer or his service agent or a similar qualified person. **LUMINAIRES WITH EMERGENCY PACK:** When supply is isolated battery output terminals may be live if battery is connected. Isolate mains and battery before servicing. Emergency luminaires require unswitched live connection taken from same phase as switched supply. When unswitched supply is connected status indicator illuminates green, when unswitched supply is disconnected indicator extinguishes and luminaire operates in emergency mode. 24 hour charge period required before undertaking full discharge test. Emergency test sheets provided should be used to record all emergency tests. Batteries should be replaced when 3 hour duration is not met. Excessive switching of permanent live may result in premature battery failure. Battery electrolyte can be harmful to eyes / open wounds, do not puncture, if electrolyte touches skin / eyes flush with water. Do not incinerate batteries.


Terminal Labelling:	
Power	
L1	Switched Live
E	Earth
N	Neutral
Emergency	
L2	Unswitched Live
DA/AT3	DALI Autotest
DA/AT3	DALI Autotest
Dimming	
-/D1/DA	Analogue/DSI/DALI
+/D2/DA	Analogue/DSI/DALI
L3	Switch Dim / Corridor Function

1. RBXRFL (Lay-In)

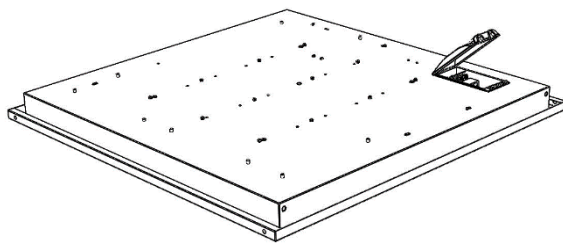


Fitting is supplied as one-piece unit.
595X595mm to rest on 15/24mm exposed T bar

2.

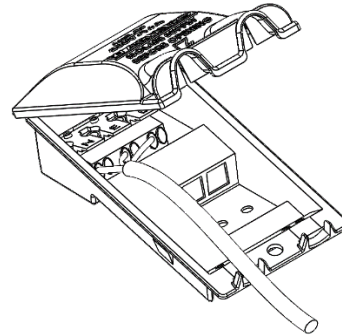


Electrical connection is made via integrated connection back-flap – allows for LEN L1 (emergency) and D1/D2 <or +/- for 1-10v> where specified.

3.

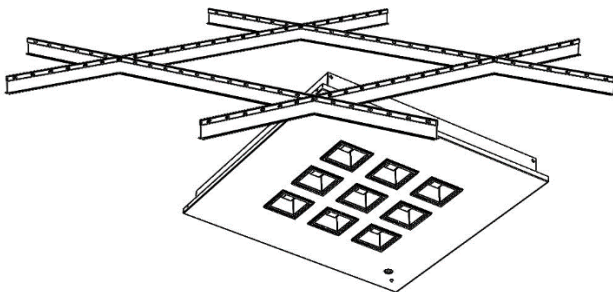

Carefully lift and tilt the luminaire into the ceiling aperture. Fitting will self-locate on grid


4.

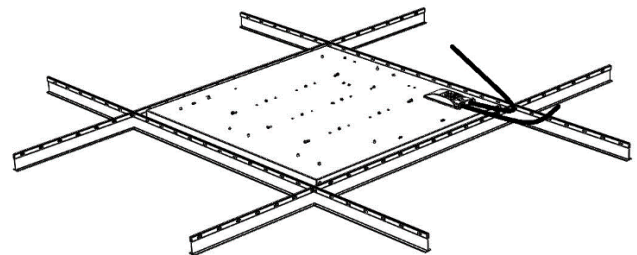


Fitting installed (shown here with loop-in / loop-out cables)

Maintenance

- ① Disconnect luminaire before undertaking any maintenance or cleaning.
- ② Cleaning should be undertaken on external parts of the luminaire only using a slightly damp lint free cloth.
- ③ To remove rear housing use a pan pozi screwdriver to remove screws.

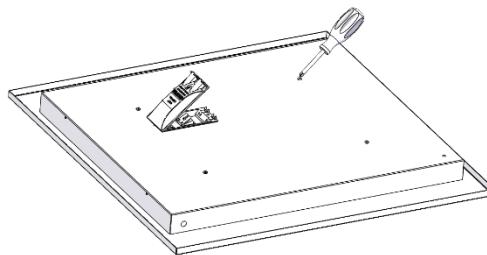

- ④ Use a pan pozi screwdriver when removing components.
- ⑤ Please contact Dextra for assistance with spare component supply.

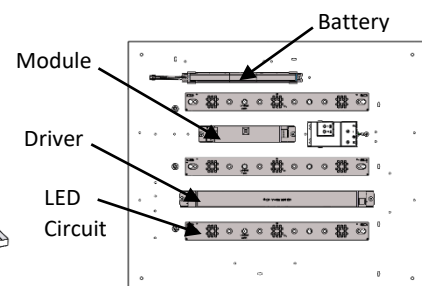

Rubix Flush (Pull-Up) Installation

220-240V / 50-60Hz
IP20



Terminal Labelling:	
Power	
L1	Switched Live
E	Earth
N	Neutral
Emergency	
L2	Unswitched Live
DA/AT3	DALI Autotest
DA/AT3	DALI Autotest
Dimming	
-/D1/DA	Analogue/DSI/DALI
+/D2/DA	Analogue/DSI/DALI
L3	Switch Dim / Corridor Function

WARNING: Luminaire must be earthed. Risk of electric shock from LED boards if operated with cover removed. Installation / operation outside of luminaires intended scope invalidates warranty. Suitable only for domestic / light industrial / industrial applications within the scope of EN55015. Tested to compliance with BSEN 60598: specification for general requirements and tests. Must be installed by a suitably qualified person in accordance with all relevant legislation. Ambient operating temperature of 0°C to 25°C. If maximum operating temperature is exceeded luminaire will automatically dim / switch off. Terminal blocks are rated to 16A unless stated otherwise. The light source contained in this luminaire shall only be replaced by the manufacturer or his service agent or a similar qualified person. **LUMINAIRES WITH EMERGENCY PACK:** When supply is isolated battery output terminals may be live if battery is connected. Isolate mains and battery before servicing. Emergency luminaires require unswitched live connection taken from same phase as switched supply. When unswitched supply is connected status indicator illuminates green, when unswitched supply is disconnected indicator extinguishes and luminaire operates in emergency mode. 24 hour charge period required before undertaking full discharge test. Emergency test sheets provided should be used to record all emergency tests. Batteries should be replaced when 3 hour duration is not met. Excessive switching of permanent live may result in premature battery failure. Battery electrolyte can be harmful to eyes / open wounds, do not puncture, if electrolyte touches skin / eyes flush with water. Do not incinerate batteries.

1.

Fitting is supplied as one-piece unit. x2 rails and x4 brackets supplied loose. Fitting measures 599X599mm – designed to pull-up <clamp> to various ceilings

2.

Fit adapter rails to rear of housing using 2No M4x5 self-tap screws as shown

3.

Fit brackets (part bent as shown) to rail – 2 brackets fit one rail – x2

4.

Regardless of ceiling type, the fixture should be offered up in aperture, then all brackets bent as shown – fixture will hang below ceiling....






5.

.. each bracket should be adjusted, ensuring fixture is tight against grid / level with tiles where applicable)... exposed T grid shown. Tighten screws on all brackets






6.

SAS 120 clip-in, fixture stops up against concealed T bar

Rubix Flush (Pull-Up) Installation
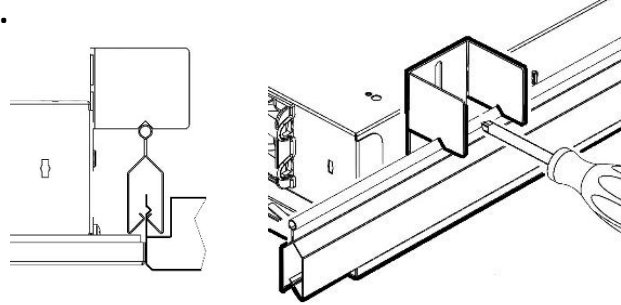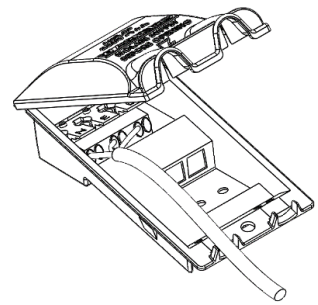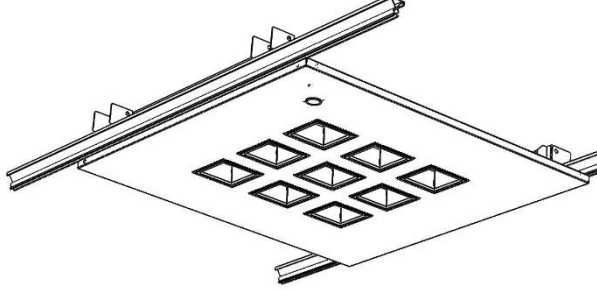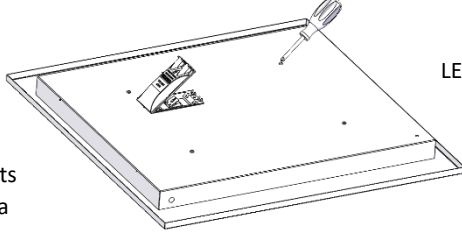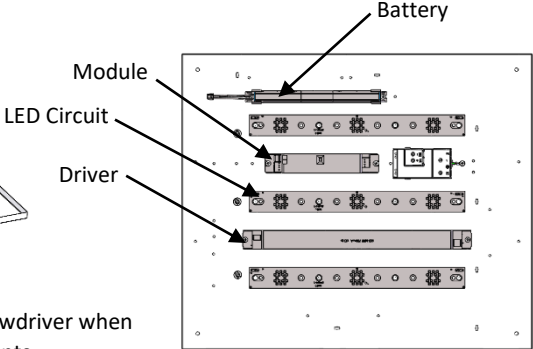
<p>7.</p>  <p>SAS 150 clip-in, fixture stops up against concealed T bar</p>	<p>8.</p>  <p>Electrical connection is made via integrated connection back-flap – allows for LEN L1 (emergency) and D1/D2 <or +/- for 1-10v> where specified.</p>
<p>9.</p>  <p>Installed fixture on SAS 120 grid (Sensored / Emergency version shown)</p>	
<p><u>Maintenance</u></p> <div style="display: flex; justify-content: space-between;"> <div data-bbox="135 1198 454 1556"> <ol style="list-style-type: none"> ① Disconnect luminaire before undertaking any maintenance or cleaning. ② Cleaning should be undertaken on external parts of the luminaire only using a slightly damp lint free cloth. ③ To remove rear housing use a pan pozi screwdriver to remove screws. </div> <div data-bbox="470 1187 933 1422">  </div> <div data-bbox="646 1444 1380 1556"> <ol style="list-style-type: none"> ④ Use a pan pozi screwdriver when removing components. ⑤ Please contact Dextra for assistance with spare component supply. </div> </div> <div style="text-align: right; margin-top: 20px;">  <p>Battery Module LED Circuit Driver</p> </div>	

Plasterboard Kit Installation
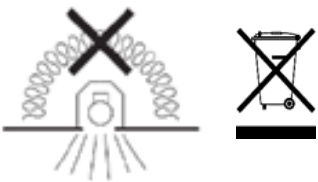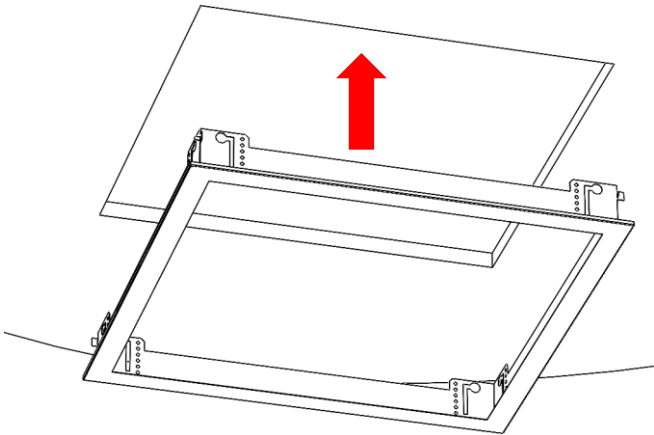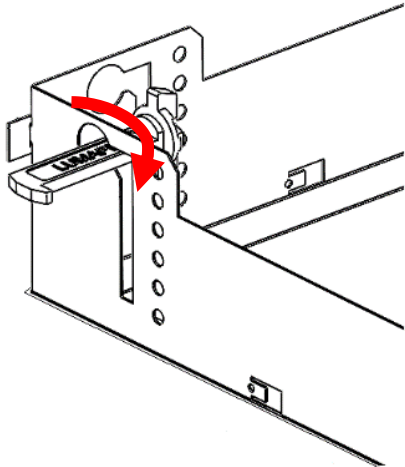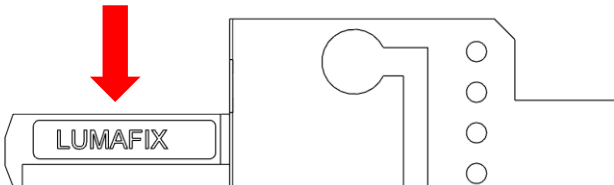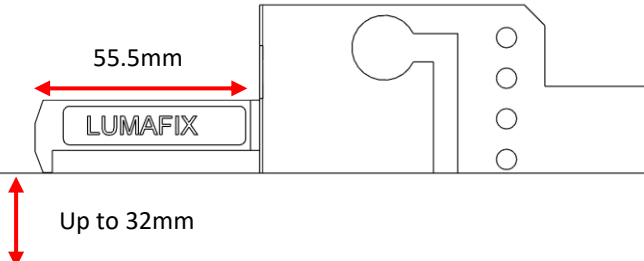
<p>IP20</p> 	
<p>1. For use with lay-in luminaires</p> <p>Cut out sizes:</p> <p>600x600 PBK = 612x612mm</p> <p>1200x600 PBK = 1212x612mm</p> <p>1200x300 PBK = 1212x312mm</p>	<p>2. Compatible fittings:</p> <ul style="list-style-type: none"> Rubini Recessed Modular Rubix Recessed Rubix Flush MOD Office MOD Slim MOD UGR MOD Curve MOD Caelus Dual Dual Square Arcus Flush Arcus Duo Arcus Mono
<p>3.</p> 	<p>4.</p> 
<p>5.</p> 	<p>6.</p>  <p>55.5mm</p> <p>Up to 32mm</p> <p>Ceilings with thickness up to 32mm</p>

